


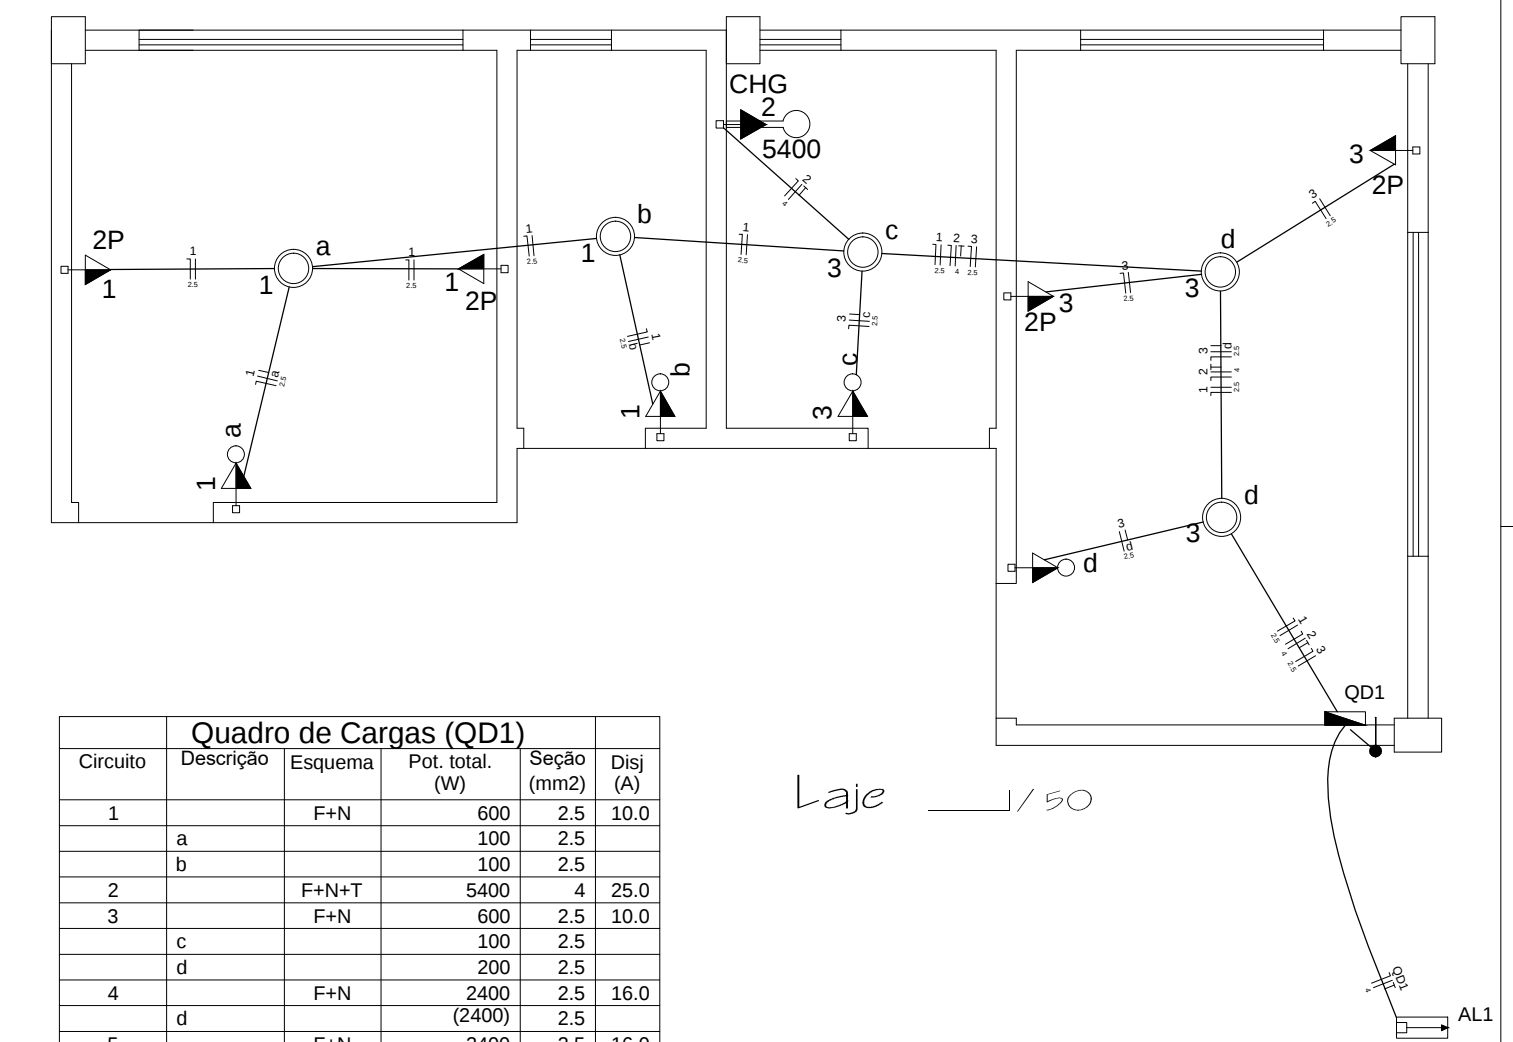

Quadro de Cargas (QD1)					
Circuito	Descrição	Esquema	Pot. total (W)	Seção (mm2)	Disj (A)
1		F+N	600	2,5	10,0
	a		100	2,5	
	b		100	2,5	
2		F+N+T	5400	4	25,0
3		F+N	600	2,5	10,0
	c		100	2,5	
	d		200	2,5	
4		F+N	2400	2,5	16,0
	d		(2400)	2,5	
5		F+N	2400	2,5	16,0
	e		(2400)	2,5	
TOTAL			11900		

AL1

Planta Baixa _____/50

	TREVISAN engenharia e arquitetura	
Av. Castelo Branco – 1060 – Parai RS, fone: 054–3477 1557		
PROPRIETÁRIO	RESP. TÉCNICO	
APACFI — PROJETO — LOCAL PARQUE MUNICIPAL DE EVENTOS - PARAI - RS — DESTINAÇÃO		
PLANTAS BAIXAS E QUADRO DE CARGAS	862,00m ²	

Planta Baixa ___/50